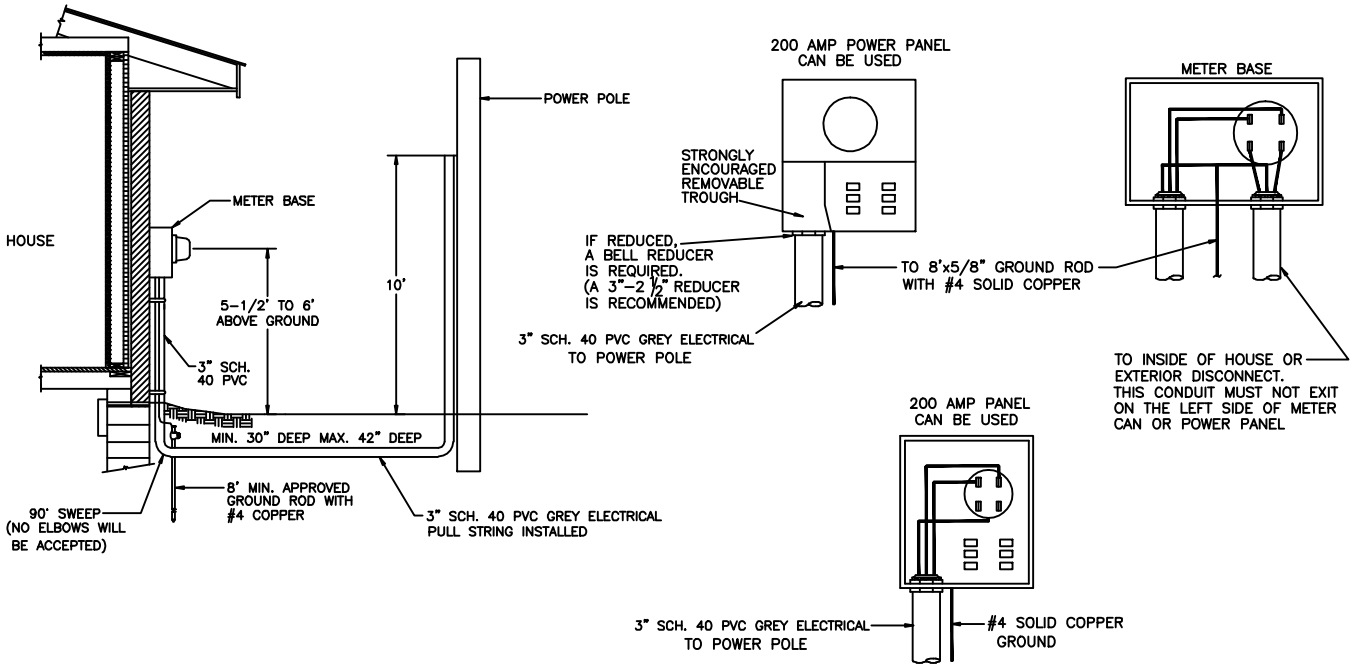

NOTES:

1. BALDWIN COUNTY E.M.C. WILL DESIGNATE THE METER LOCATION AND CONDUIT ROUTE.
2. NO MORE THAN TWO (2) SWEEP 90° TURNS WILL BE PERMITTED IN ANY SERVICE.
3. FOR 400 AMP SEE UNDERGROUND POLICY.

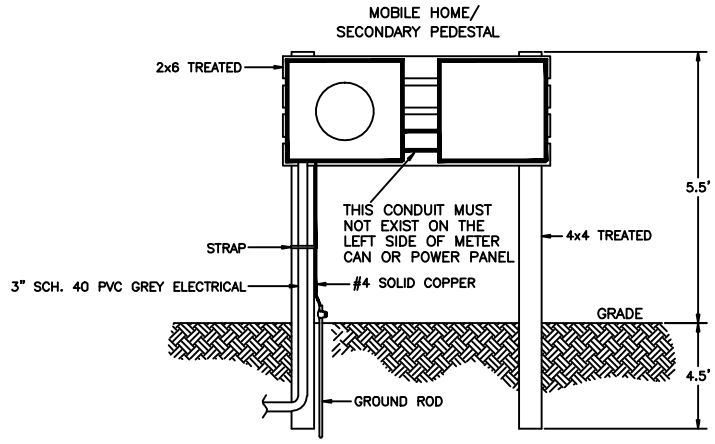

200 AMP METER BASE AND PANEL
(TO BE RAIN-TIGHT) OR
200 AMP POWER PANEL CAN BE USED

NOTES:

1. BALDWIN COUNTY E.M.C. WILL DESIGNATE THE METER LOCATION AND CONDUIT ROUTE.
2. NO MORE THAN TWO (2) SWEEP 90° TURNS WILL BE PERMITTED IN ANY SERVICE.
3. FOR 400 AMP SEE UNDERGROUND POLICY.
4. 200 AMP OR LESS INSTALL (2)-10' TREATED 4X4 POSTS (NEW) 4-1/2' DEEP AND 5-1/2' ABOVE GROUND.
5. WHEN USING POWERPANEL, (1) 10' TREATED 6X6 POST MAY BE PERMITTED 4-1/2' DEEP AND 5-1/2' ABOVE GROUND.

DWN. BY: D. LITTLE	DATE: 7/9/09	TITLE: SPECS, SINGLE PHASE U.G. SERVICE ENTRANCE	
ENG. APPROV: B. SEALS	7/9/09	SCALE: N.T.S.	200 AMP OR LESS | SHEET 1 OF 1